


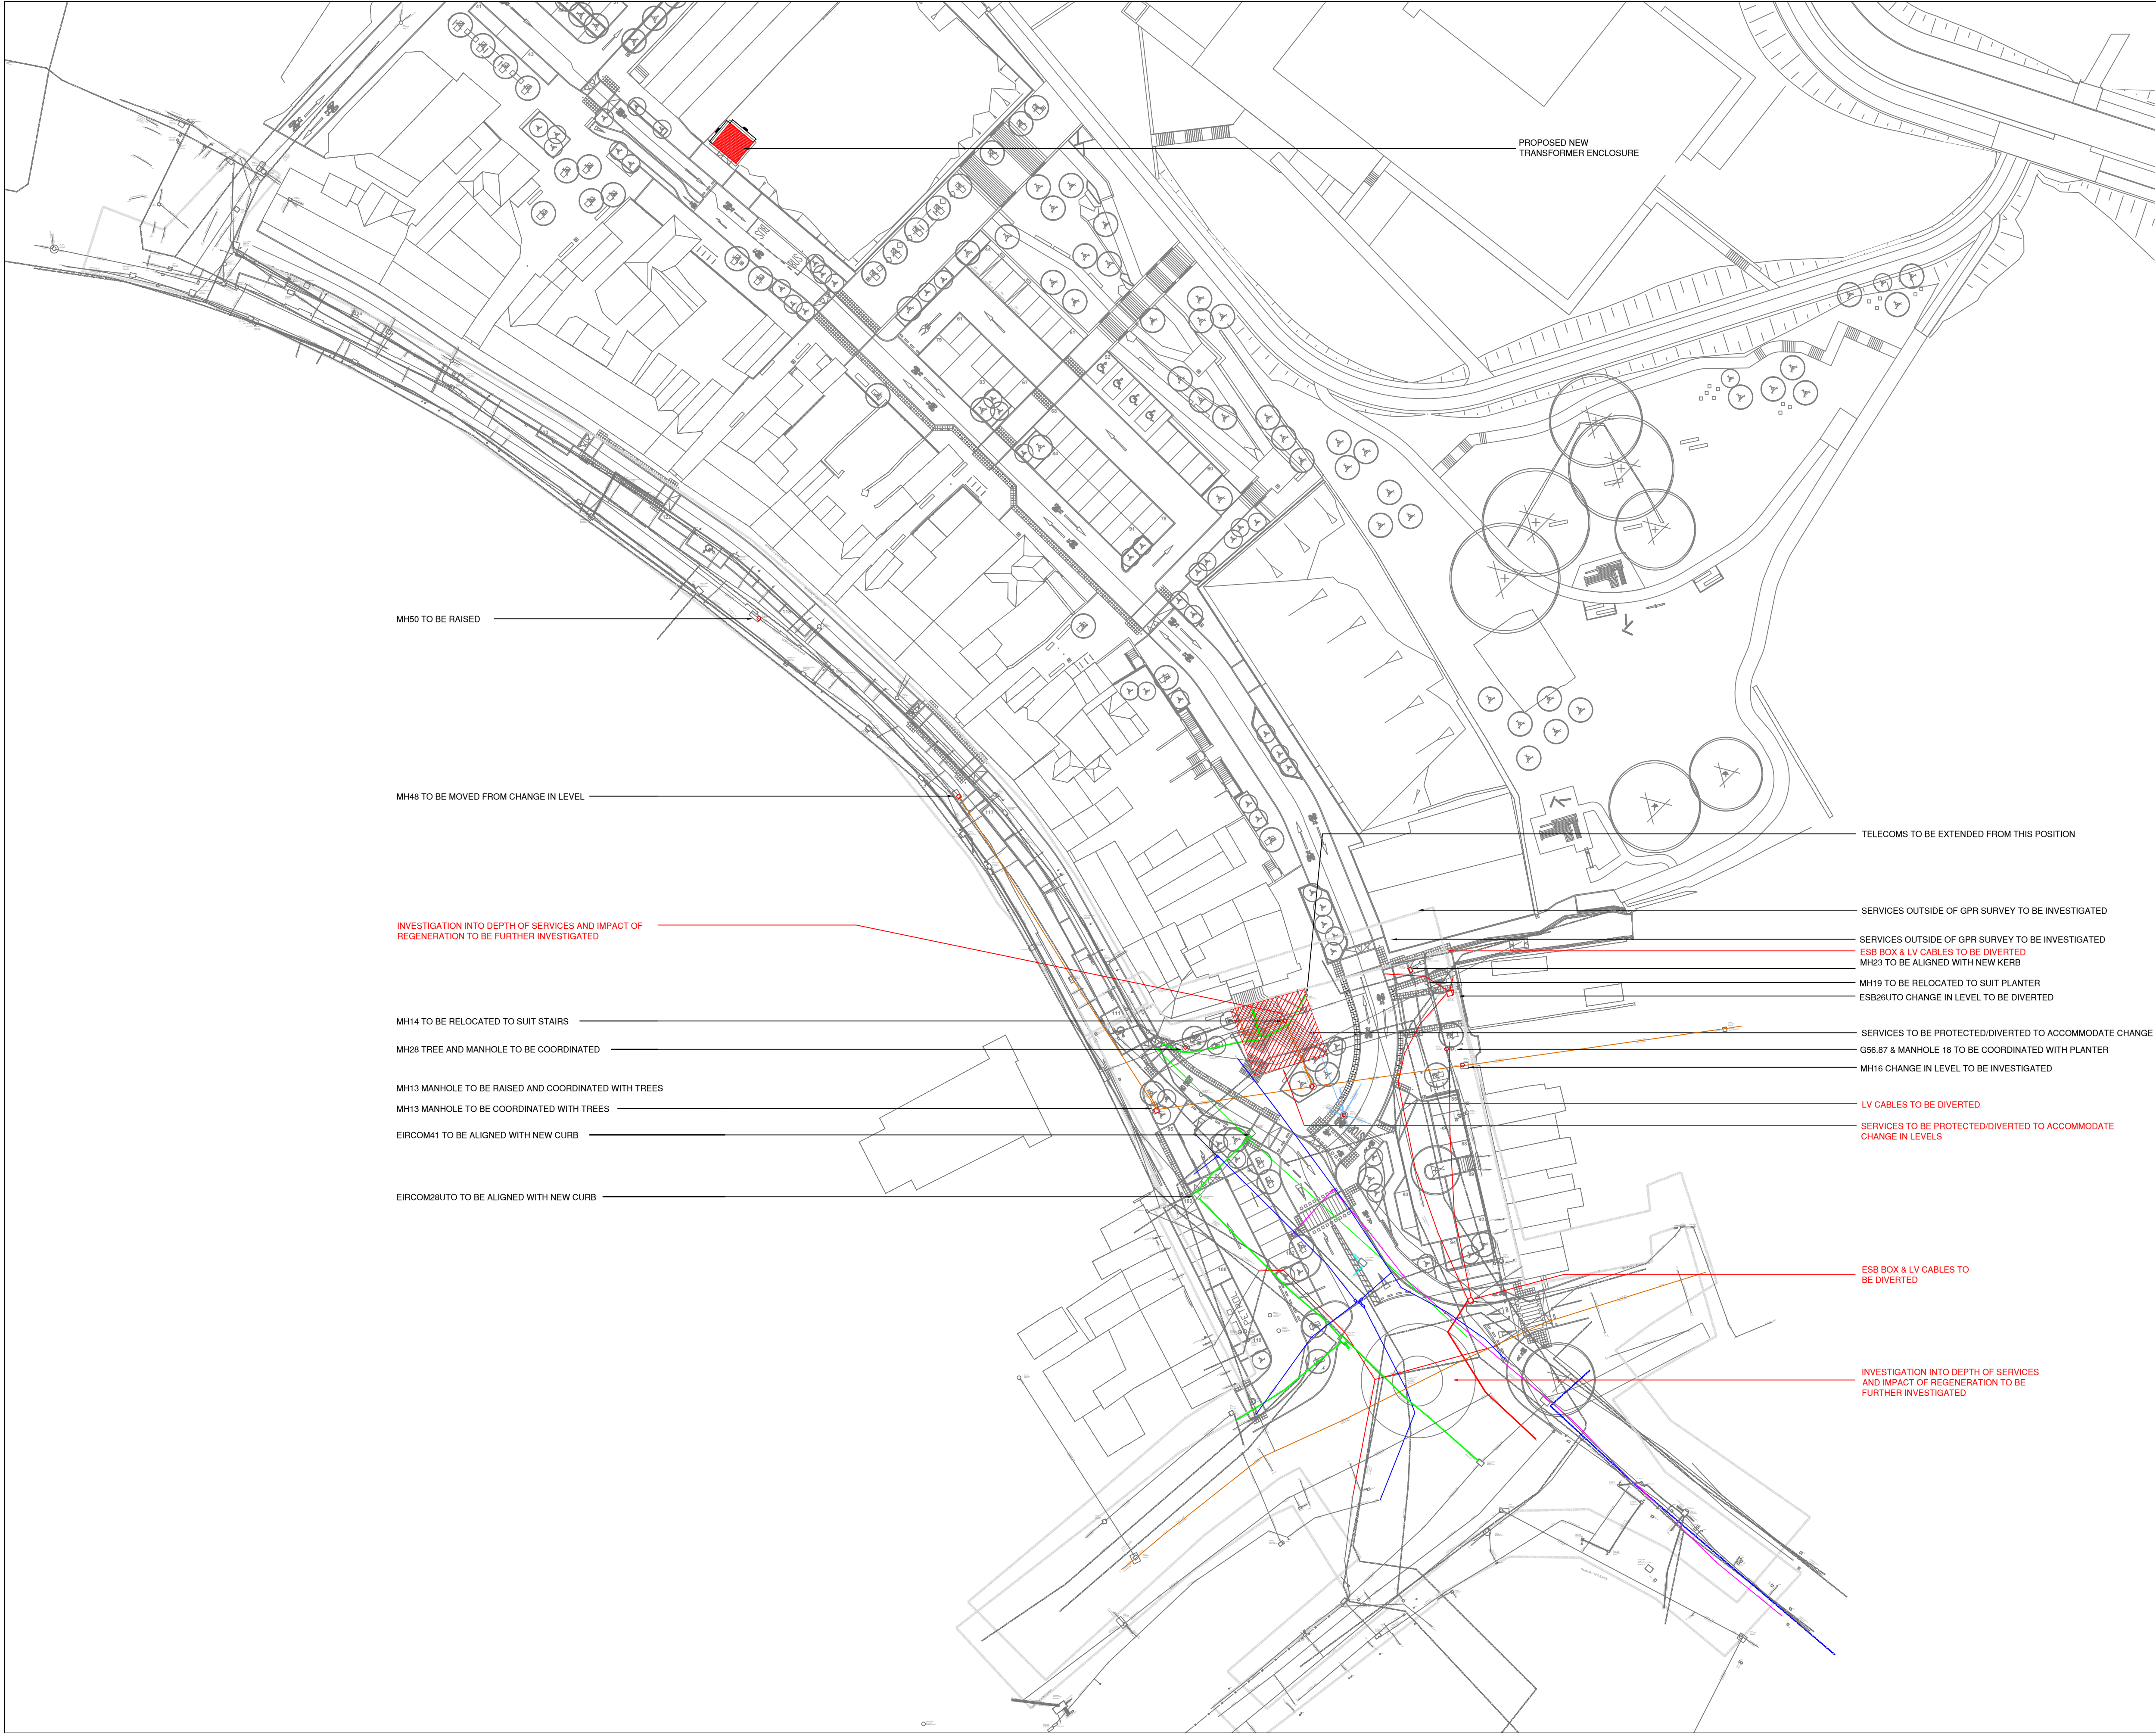

NOTES:
1. THIS DRAWING IS THE PROPERTY OF DELAP & WALLER AND MAY ONLY BE USED WITH THEIR WRITTEN APPROVAL
2. DO NOT SCALE FROM THIS DRAWING.

LEGEND - CABLES/PIPES TO BE STRIPPED BACK / REMOVED / PROTECTED

- LV CABLE DIVERSION
- WATER PIPELINE DIVERSION
- COMMS CABLE DIVERSION
- UNKNOWN SERVICE DIVERSION
- ALL SERVICES WITHIN 2 METER BOUNDARY TO BE DIVERTED OR PROTECTED AS INDICATED ON THE DRAWING.

LEGEND - CABLE DIVERSION ROUTES

- LV CABLE DIVERSION ROUTE
- WATER PIPELINE DIVERSION ROUTE
- COMMS CABLE DIVERSION ROUTE
- UNKNOWN SERVICE DIVERSION ROUTE
- NEW INSPECTION CHAMBER

Location	TABLE 06					Equipment Pipework mm
	Cable mm	HV mm	LV mm	Telephone mm	Co-axial mm	
Buried:						
HV	50	300	300	300	300	300
LV	300	25	300	150	150	300
Telephone	300	150	50	50	50	300
Co-axial	300	150	150	150	150	300
Fibre Optic	300	150	50	50	50	300
In Air:						
HV	50	300	300	300	300	300
LV	300	(see note 2)	150	150	150	300
Telephone	300	150	0	0	0	300
Co-axial	300	150	0	0	0	300

NOTES:
1. The minimum spacing apply unless otherwise indicated.
2. LV cables in air may be bunched subject to any requirements regarding segregation and installation methods set out in BS 7671: Requirements for Electrical Installations, Guidance Note No. 1, and as stated in 6.2.
3. When cables are in steel pipes the minimum spacings need not be maintained, but a minimum space of 25mm shall be left between the pipes.

PO4	ADB	ISSUED FOR PLANNING	27.01.2024
PO3	ADB	ISSUED FOR PLANNING	05.12.2024
PO2	ADB	PRELIMINARY DRAWING	15.11.2024
PO1	ADB	PRELIMINARY DRAWING	12.08.2024

REV	BY	DESCRIPTION	DATE
-----	----	-------------	------

PROJECT:
DUBLIN STREET NORTH
REGENERATION



www.delapandwaller.com
☐ Antrim: T +44 (0) 28 9448 3800
☐ Dublin: T +353 (0) 1 535 5900
☐ London: T +44 (0) 20 8059 7373

CLIENT:
MONAGHAN COUNTY COUNCIL

SCALE AT A1: 1:500	CHK: ADB DES: ADB	APP: RS DRW: ADB
-----------------------	----------------------	---------------------

WORK PACKAGE:
M&E DESIGN

DRAWING TITLE:
DIVERSIONS

DRAWING NUMBER:
Project Originator Zone Level Type Role - Number
22268 DLW- XX - XX - XX - E - 00400

SUITABILITY:
Suitable for review and comment
REV:
P04